




TEL 512.899.3500
FAX 512.899.3501

4330 S. MOPAC EXPWY
SUITE ONE HUNDRED
AUSTIN TEXAS 78735
www.stgarch.com

© 2004 SUSMAN TISDALE GAYLE - ALL RIGHTS RESERVED




MEJ & ASSOC., INC.
Consulting Engineers
811 Barton Springs Road
Austin, Texas 78704
512-497-0771

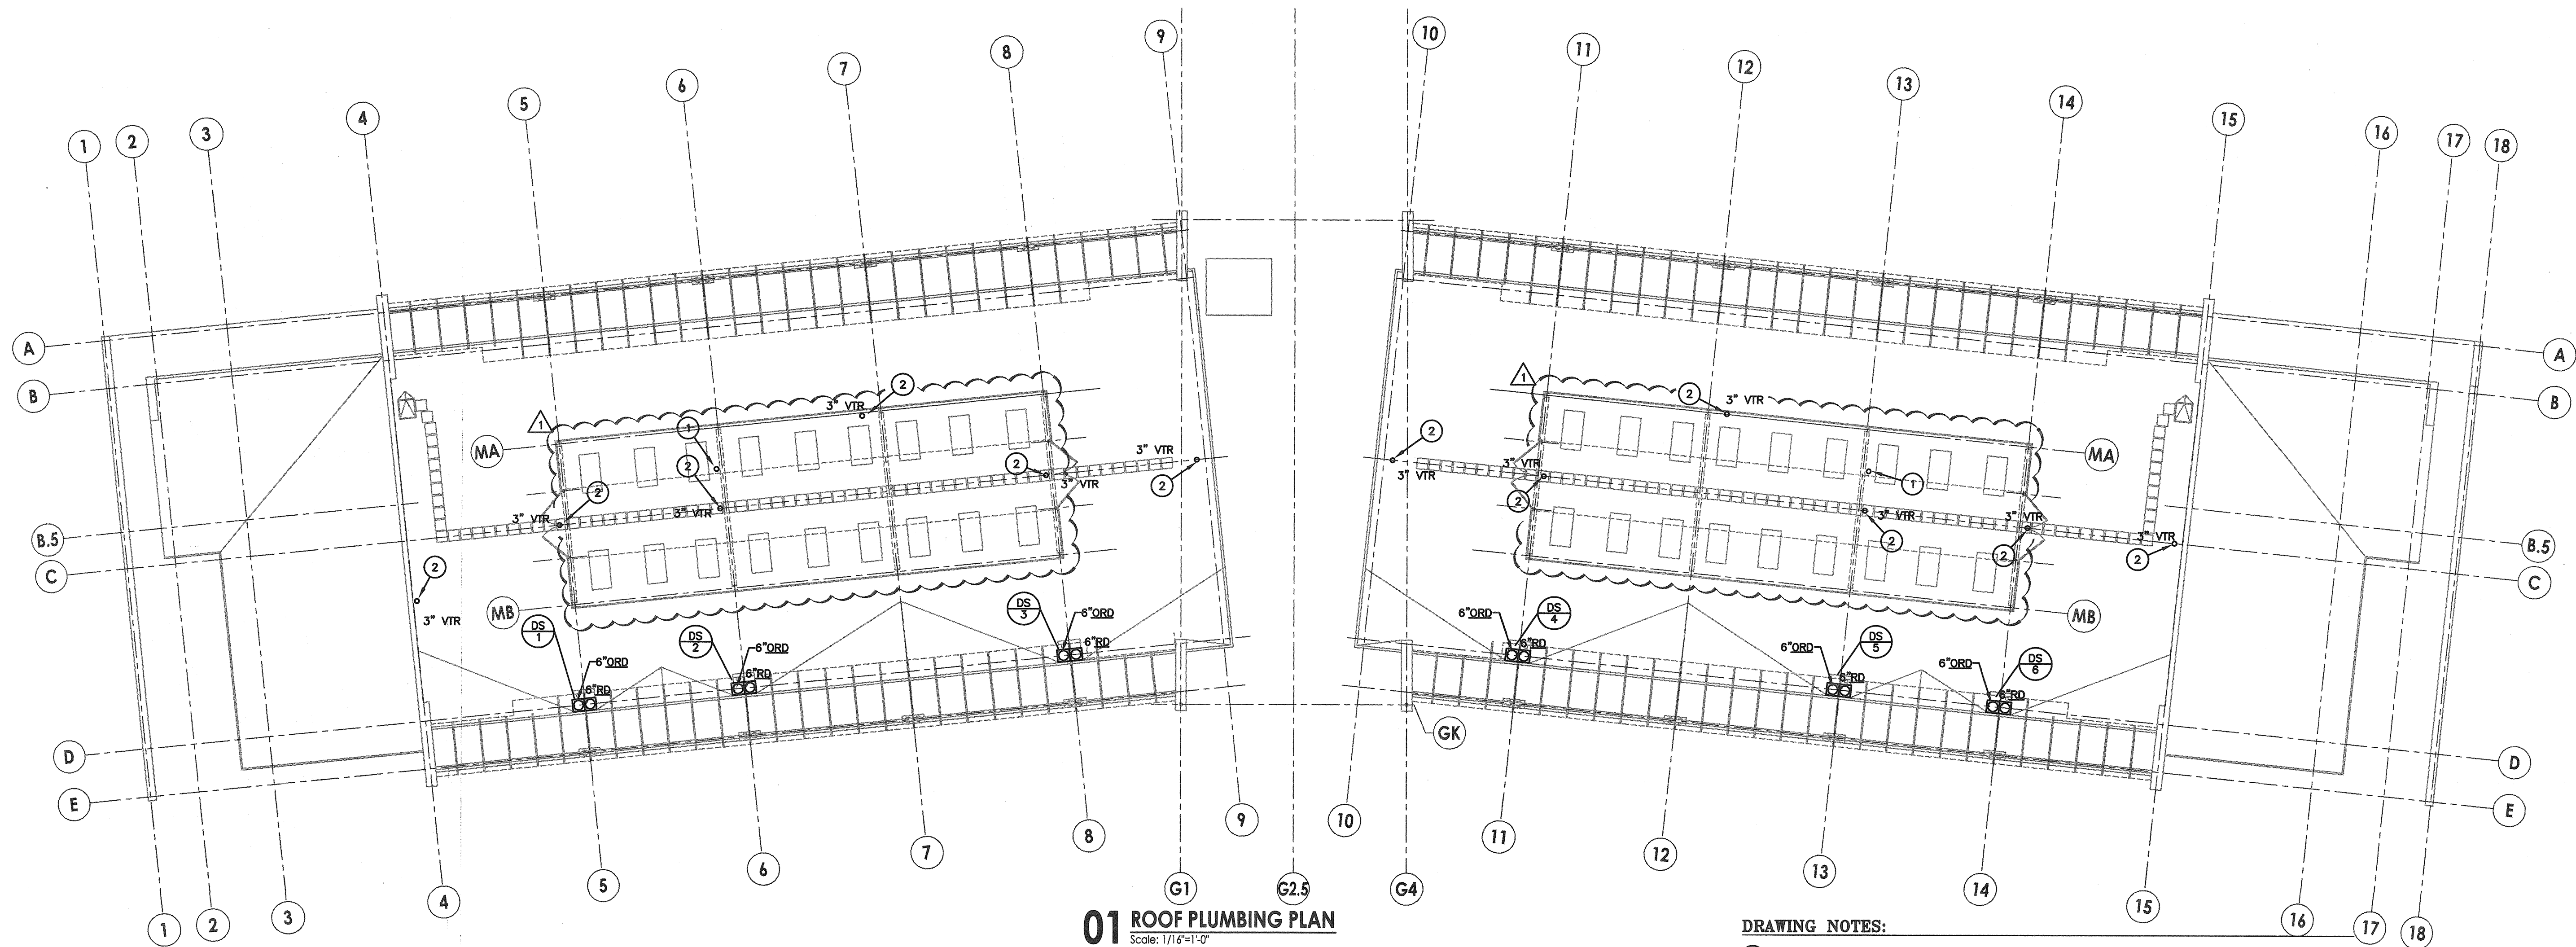

DRAWING NOTES:


- MAPA MPH-24 FP FREEZE PROOF PEDESTAL HYDRANT. PROVIDE 3/4\"
- 3\"

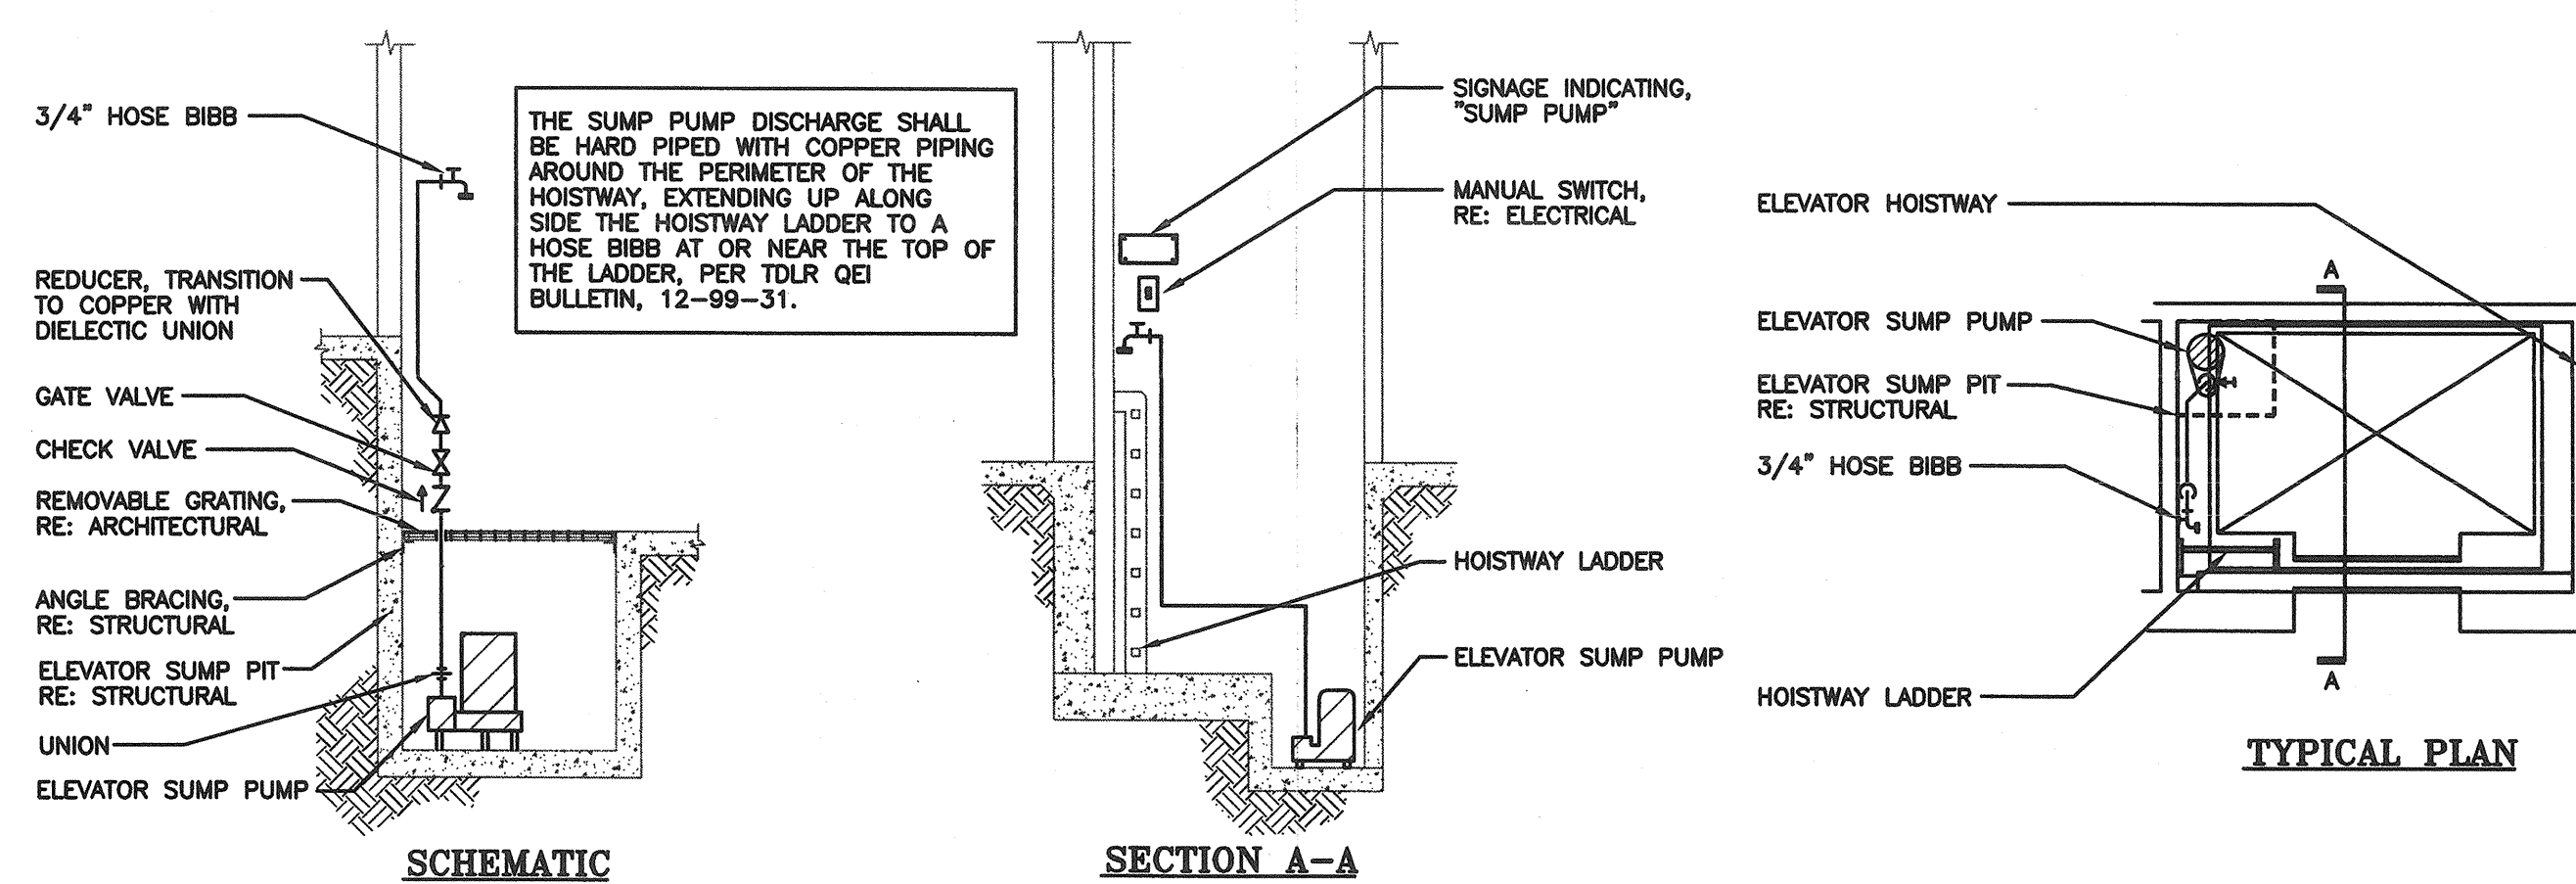

- NOTES:
- REFERENCE PLUMBING PUMP SCHEDULE FOR ELEVATOR SUMP PUMP SPECIFICATIONS.

03 ELEVATOR SUMP PUMP DETAIL

Scale: NONE

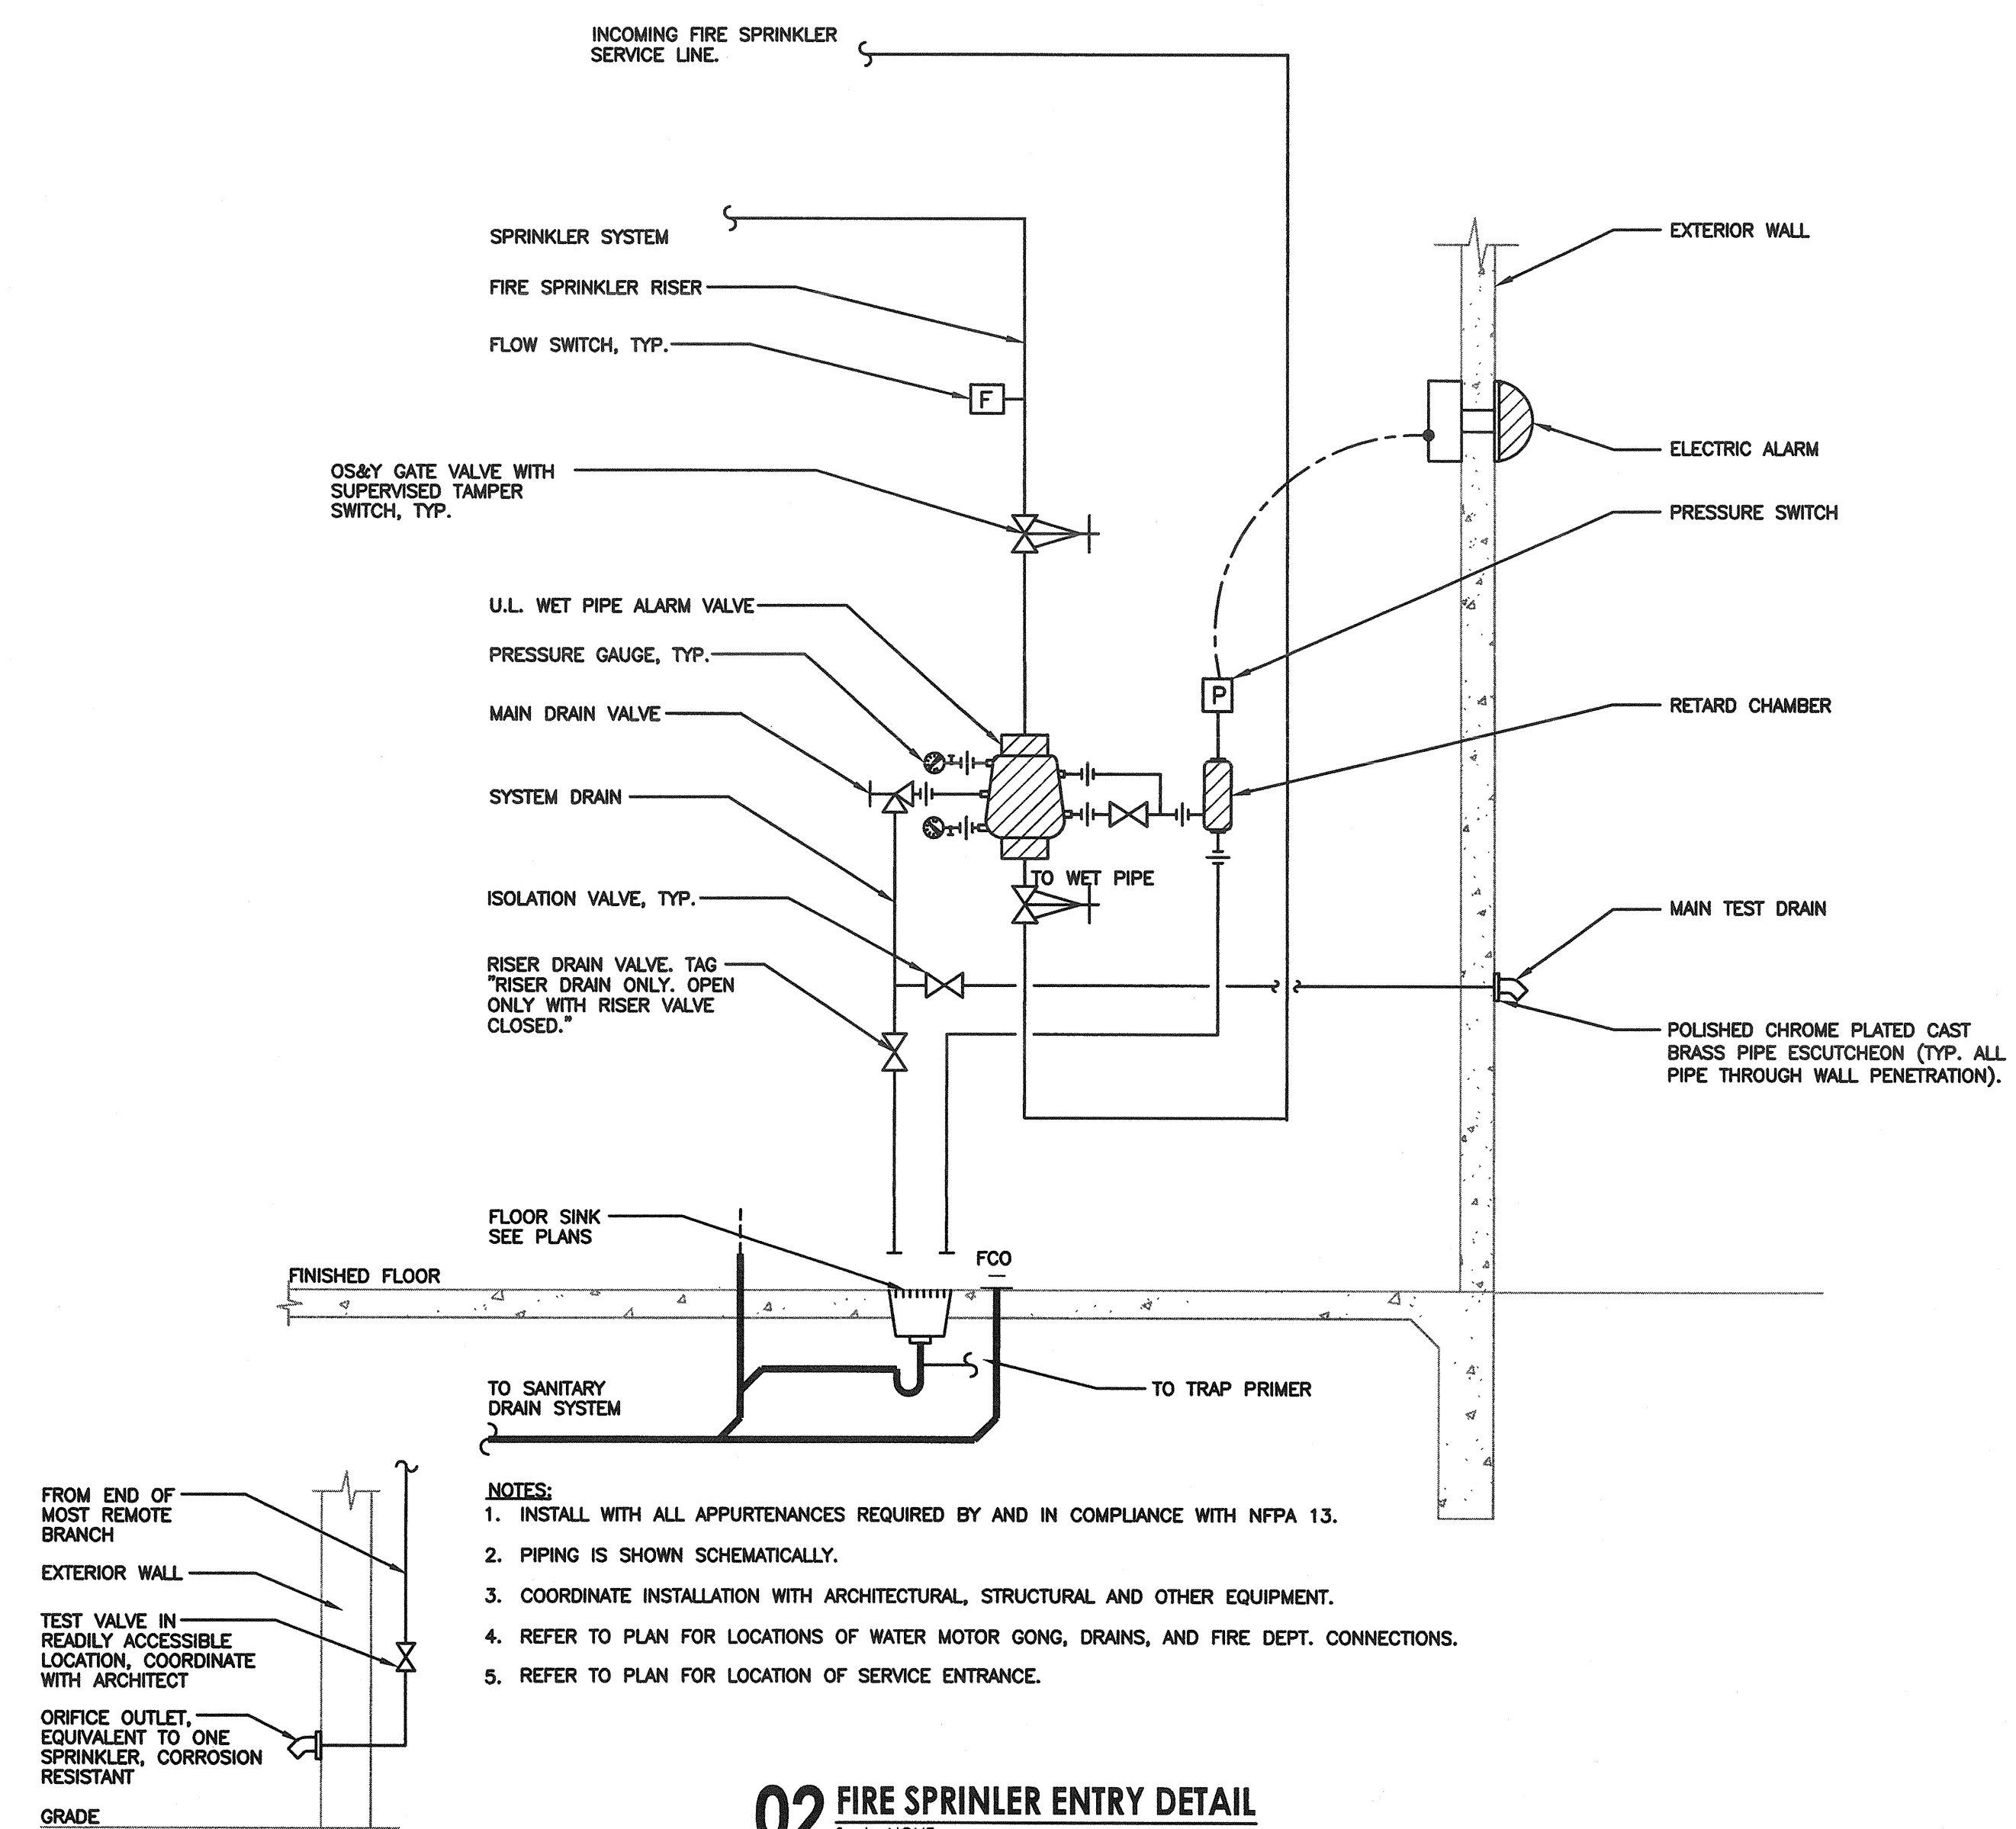

- NOTES:
- INSTALL WITH ALL APPURTENANCES REQUIRED BY AND IN COMPLIANCE WITH NFPA 13.
 - PIPING IS SHOWN SCHEMATICALLY.
 - COORDINATE INSTALLATION WITH ARCHITECTURAL, STRUCTURAL AND OTHER EQUIPMENT.
 - REFER TO PLAN FOR LOCATIONS OF WATER MOTOR GONG, DRAINS, AND FIRE DEPT. CONNECTIONS.
 - REFER TO PLAN FOR LOCATION OF SERVICE ENTRANCE.

02 FIRE SPRINKLER ENTRY DETAIL

Scale: NONE

LADERA BEND

PACKAGE B
RETAIL BUILDING

Project 14-5234-00
Drawn 08.01.06
Quality Control SMM
Project Director

Issues
CONSTRUCTION 02-02-07
PR #7 1/28/08

ROOF PLUMBING
PLAN AND DETAILS